


NOTES:

1. AN APPROVED EPOXY COAT BETWEEN THE CURB & PAVEMENT SURFACE SHALL BE USED.
2. SEE NOTES FOR TYPE I CURB & GUTTER, DWG. W-16.1
3. ALL CONC FOR TYPE I OR TYPE 2 P.C.C. MEDIAN CURB SHALL BE REINFORCED W/ COLLATED, FIBRILLATED POLYPROPYLENE FIBERS AS MANUFACTURED BY FIBERMESH OR APPROVED EQUAL. REINFORC'G SHALL BE 1 1/2 LBS. OF FIBERMESH PER CU. YD. OF CONCRETE.
4. ALL NOSES ON MEDIAN CURB SHALL BE POURED SOLID FOR THE FULL WIDTH OF THE MEDIAN.
5. CONCRETE SHALL BE MIN. 6.25 sacks OF TYPE II CEMENT (588 lbs) PER CU. YD. CONC. 4000 PSI COMPRESSIVE STRENGTH @ 28 DAYS WITH 4.5 - 7.5% AIR.

REINFORCING
(NOTE 3)

TYPE I P.C.C. MEDIAN CURB

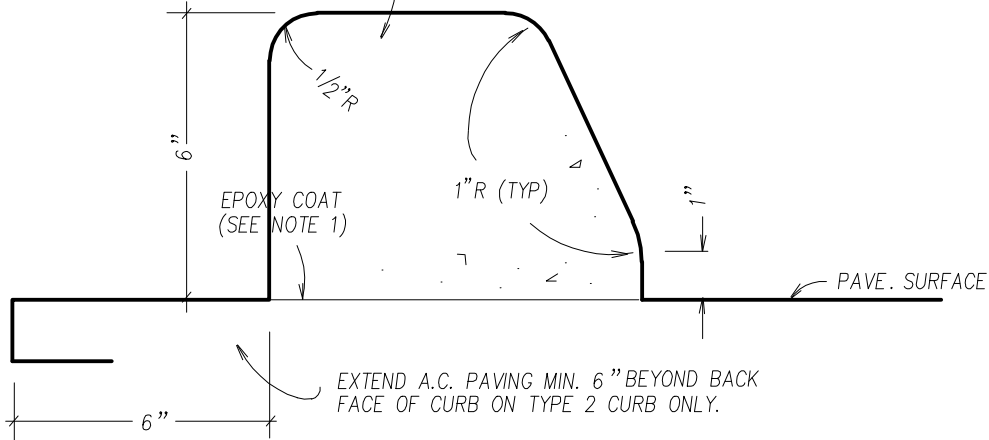

TYPE 2 P.C.C. MEDIAN CURB

NO.			REVISIONS			DATE			STANDARD DETAILS FOR PUBLIC WORKS CONSTRUCTION			SECTION	
1			REDRAW			11/92vp			P.C.C. MEDIAN CURB			WASHOE	
2			Add notes			2/94vp						DRAWING NO.	
3			Add note 5			12/11sw						W-17	
									DATE 11/92vp		PAGE 33		