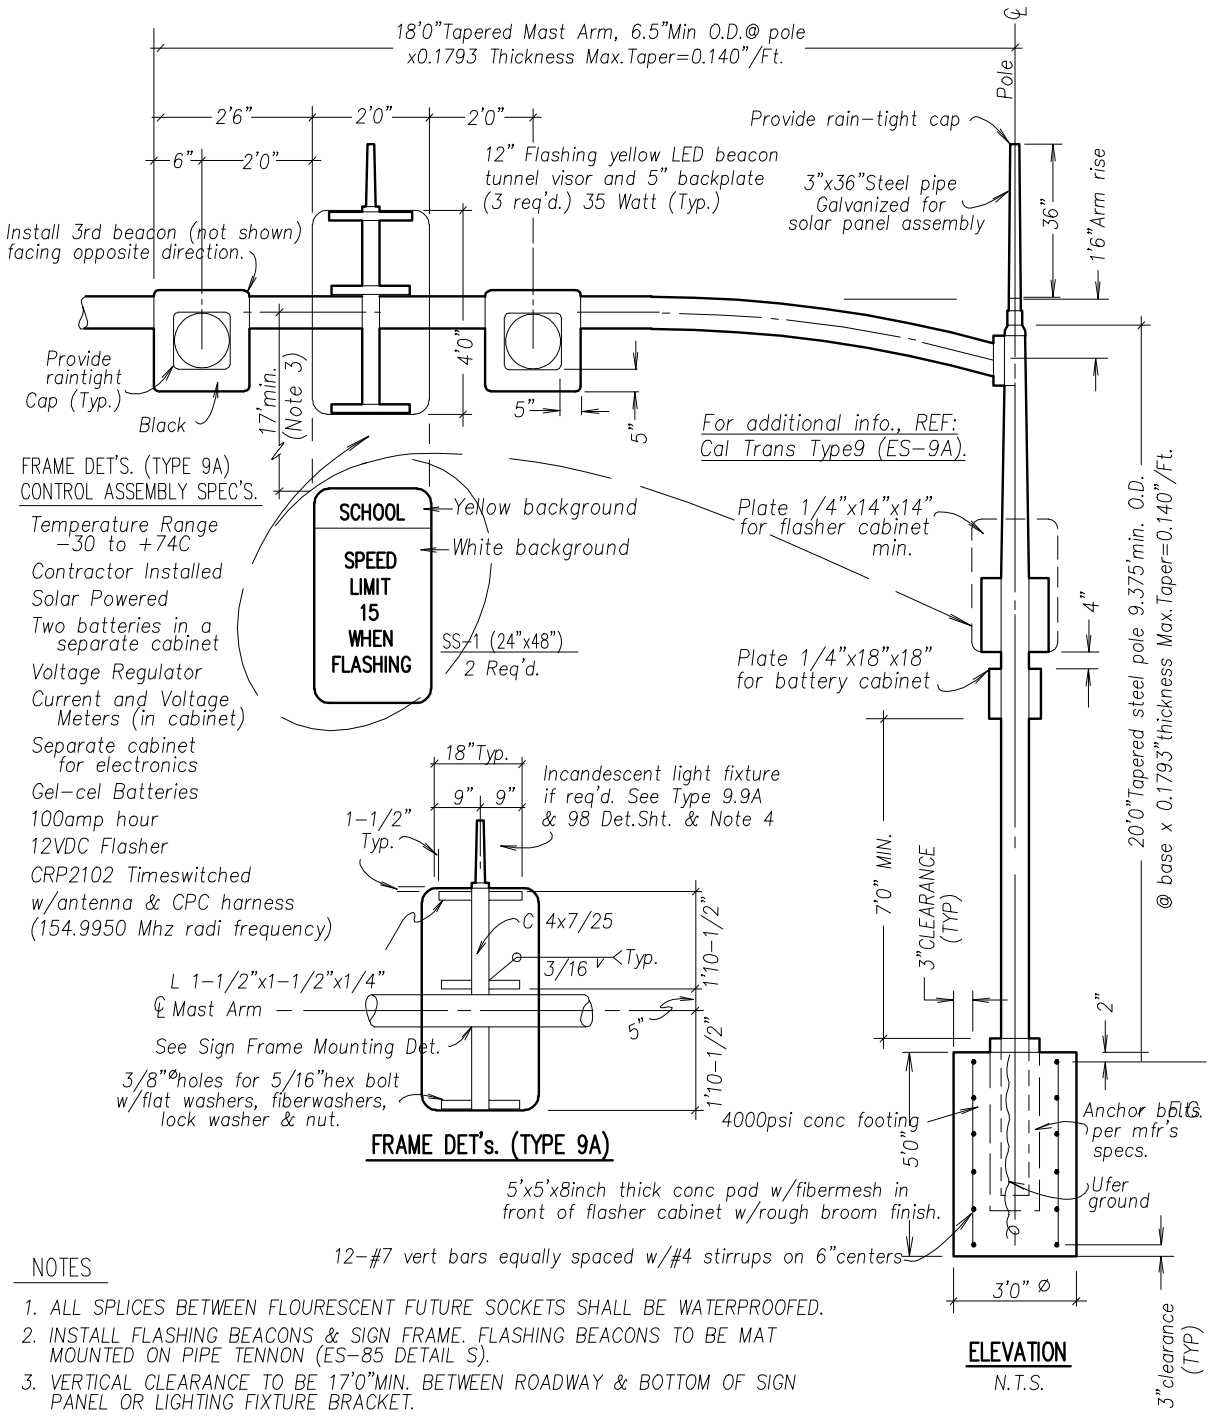

FRAME DET's. (TYPE 9A)

ELEVATION
N.T.S.

NOTES

1. ALL SPLICES BETWEEN FLOURESCENT FUTURE SOCKETS SHALL BE WATERPROOFED.
2. INSTALL FLASHING BEACONS & SIGN FRAME. FLASHING BEACONS TO BE MAT MOUNTED ON PIPE TENNON (ES-85 DETAIL S).
3. VERTICAL CLEARANCE TO BE 17'0"MIN. BETWEEN ROADWAY & BOTTOM OF SIGN PANEL OR LIGHTING FIXTURE BRACKET.
4. SPECIAL PROVISIONS OR PLANS WILL INDICATE WHEN INCANDESCENT LIGHTING FIXTURE IS REQUIRED ON TYPE 9A OR 9B SIGN FRAMES.
5. ALL TYPE 9 SIGN FRAMES SHALL BE PROVIDED WITH A 36" FLOURESCENT SIGN LIGHTING EQUIPMENT.
6. ANCHOR BOLTS SHALL BE ASTM A-307.
7. ALL CONCRETE SHALL BE MIN. 6.5 SACKS OF TYPE II CEMENT (611 LBS) PER CU. YD. OF CONCRETE-4000 PSI COMPRESSIVE STRENGTH @ 28 DAYS WITH 4.5 - 7.5% AIR.

NO.	REVISED	DATE
1	NOTE 7	12/11sw

STANDARD DETAILS FOR PUBLIC WORKS CONSTRUCTION

SCHOOL SIGNAL

SECTION: WASHOE

DRAWING NO: W-20

DATE: 10/01vp

PAGE: 36